ELECTRICAL LEGEND

- RECESSED FIXTURE
- LED CABINET LIGHTING
- CEILING MOUNTED FIXTURE
- WALL MOUNTED FIXTURE
- EXHAUST FAN/ LIGHT FIXTURE
- MULTI LIGHT PENDANT UNIT SINGLE CIRCUIT WITH DIMMER
- LIGHTED EXIT SIGN WITH BATTERY BACKUP
- DUPLEX RECEPTACLE
- 220V RECEPTACLE
- CEILING OR FLOOR RECEPTACLE
- SINGLE POLE SWITCH
- THREE WAY SWITCH
- FOUR WAY SWITCH
- WP — WATER PROOF & GFCI
- DIM — DIMMER
- GFCI — GROUND FAULT CIRCUIT INTERRUPTER
- SURFACE MOUNTED FLUORESCENT FIXTURE

NOTES:

ELECTRICAL OUTLETS SHALL BE LOCATED WITHIN A REASONABLE DISTANCE OF WHERE SHOWN ON PLANS.
ALL ELECTRICAL LIGHTING FIXTURES, RECEPTACLE OUTLETS AND SMOKE DETECTORS SHALL BE ARC FAULT PROTECTED. RECEPTACLES SHOWN AS GFCI SHALL BE GROUND FAULT PROTECTED.
EXTERIOR ELECTRICAL SERVICE SHALL BE DETERMINED ON SITE BY ELECTRICAL CONTRACTOR AND OR THE LOCAL POWER COMPANY
ELECTRICAL SYSTEM SHALL COMPLY WITH SECTION E3501, E3601, E3701, E3801, E3901 and E4001
MECHANICAL SYSTEM SHALL COMPLY WITH M1301, M1401 and M1601
NOTE: ELECTRICAL AND COMMUNICATION OUTLETS AND SWITCHES SHALL BE AT OR ABOVE REQ'D BFE OR APPROVED FOR WET CONDITIONS.

WESCO DISTRIBUTION, GULFPORT, MISSISSIPPI, 228 864 9090 (BILLY BONNEY) HAS A DWG FILE OF THE ELECTRICAL AND SITE PLAN AND WILL FREE OF CHARGE SPEC THE FIXTURES AS PER YOUR REQUEST.

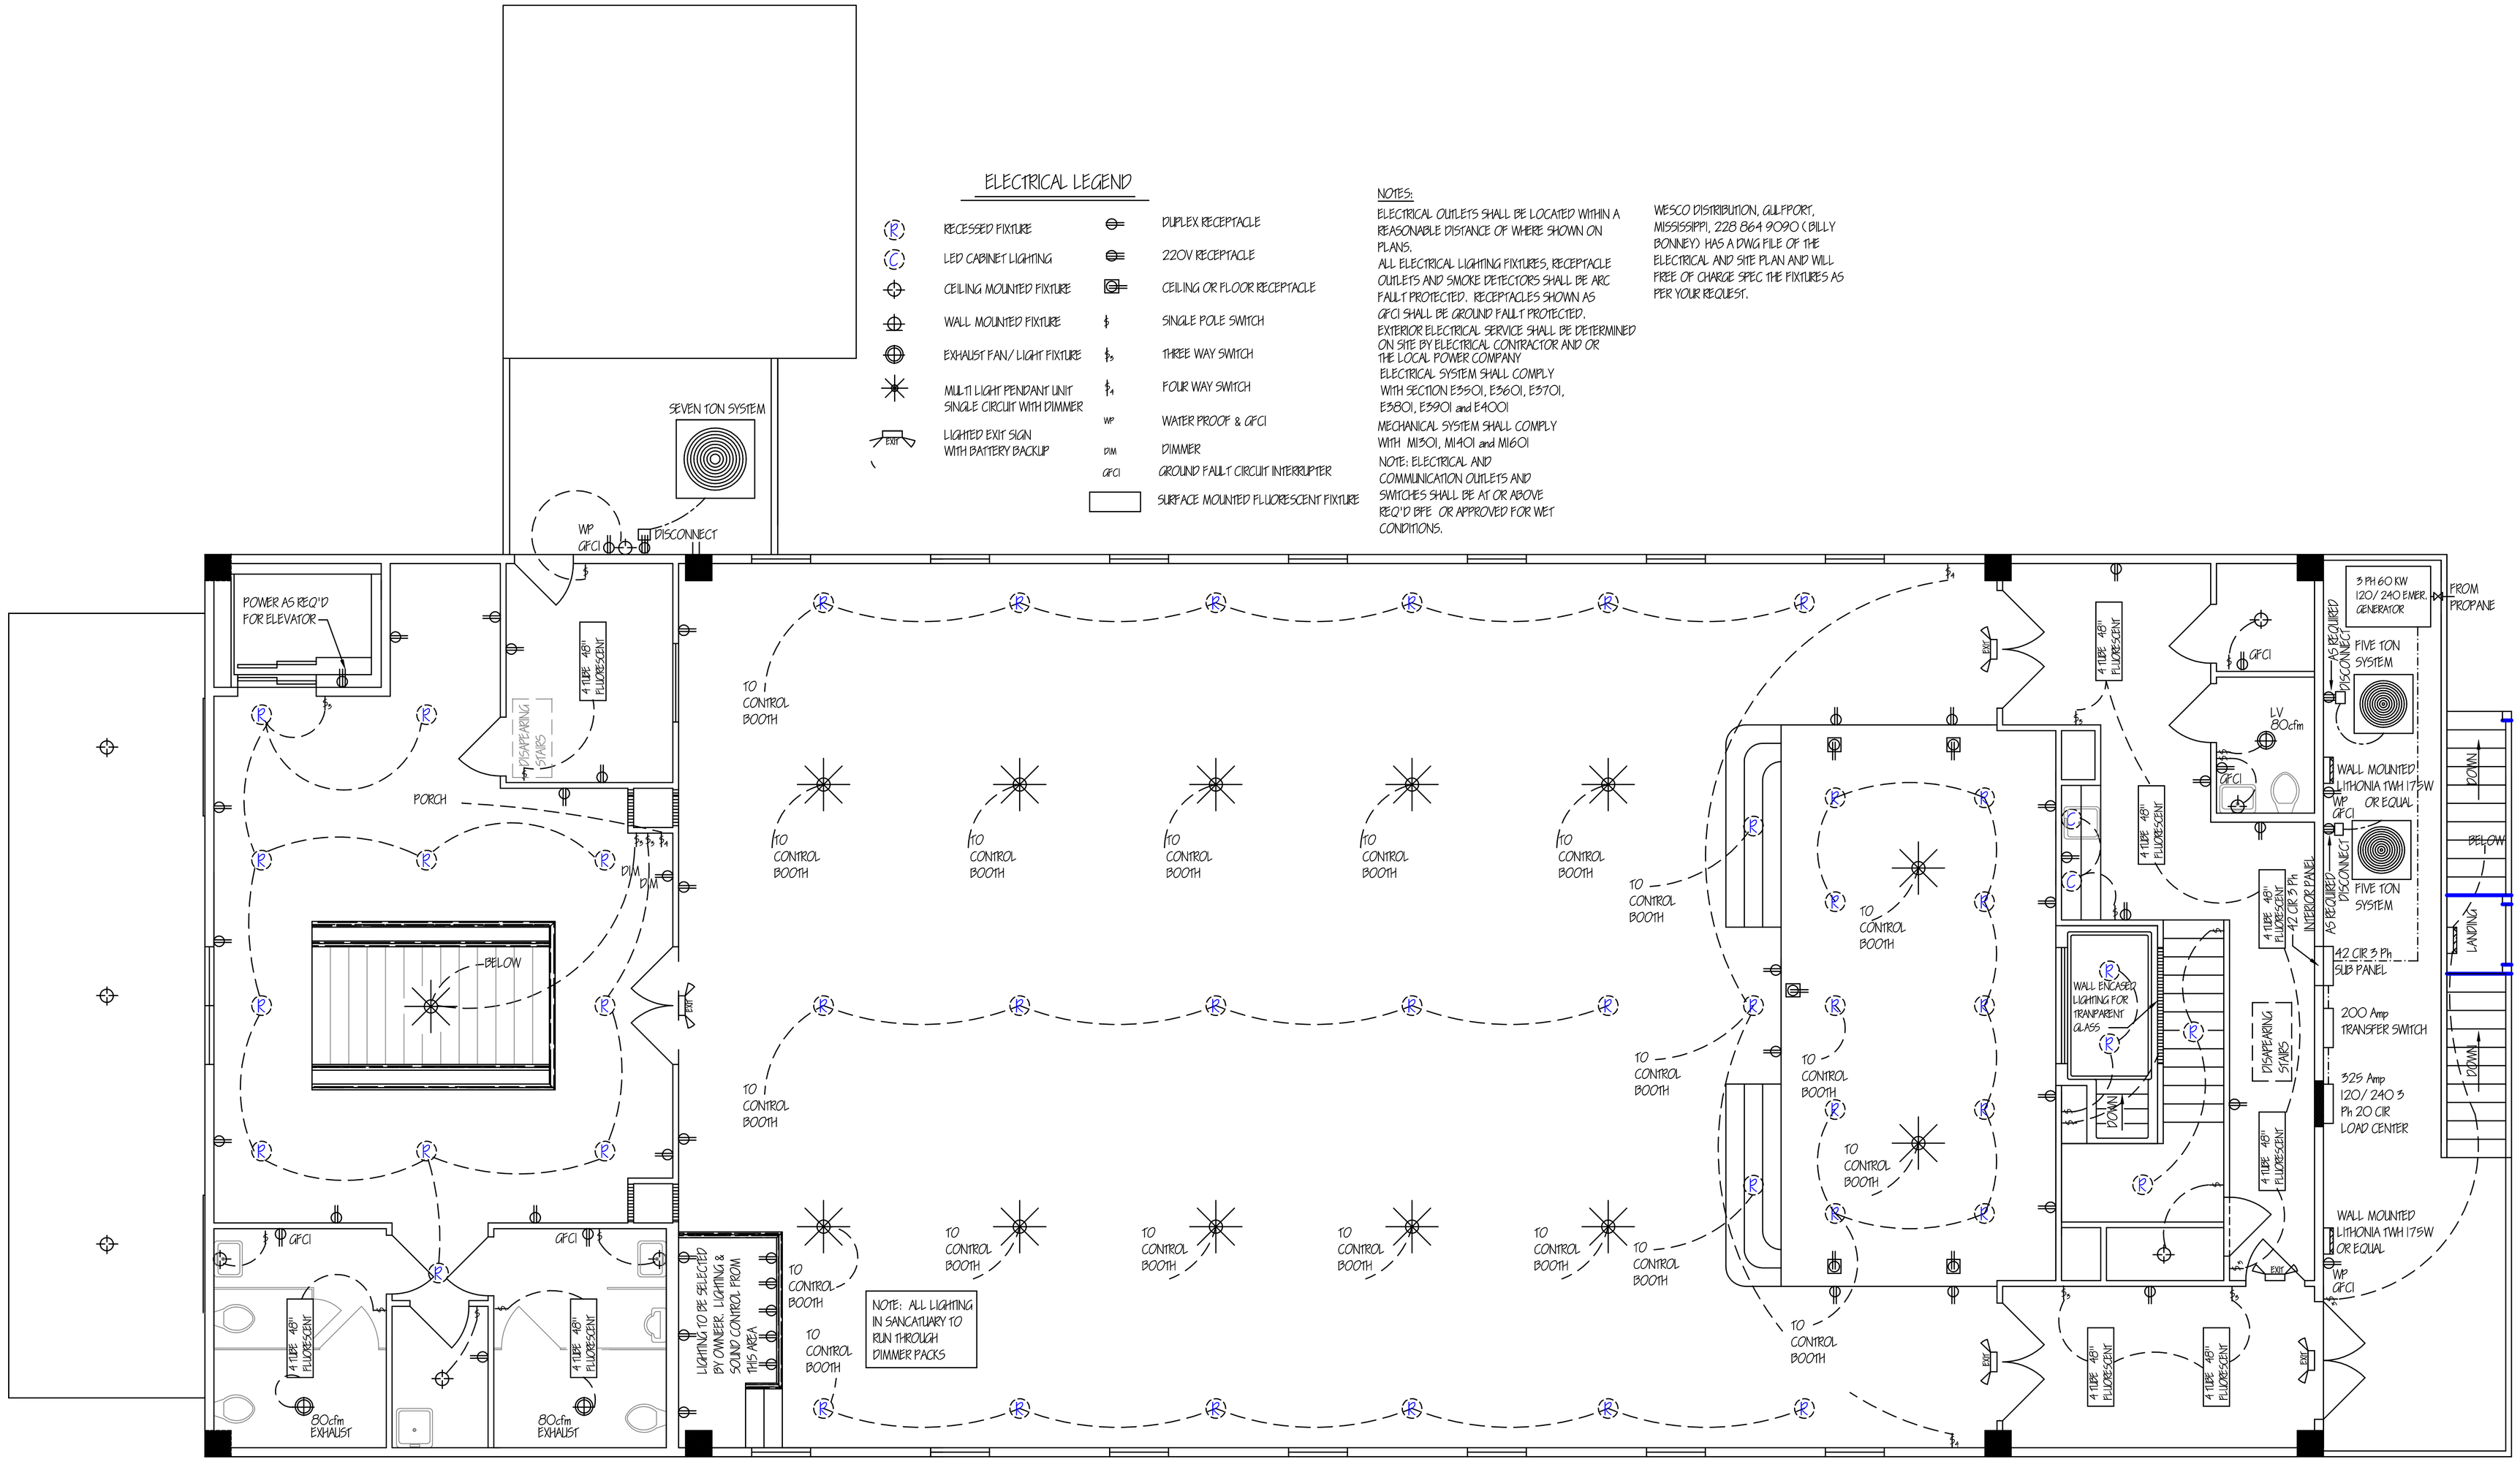

MAIN FLOOR ELECTRICAL

BUILDING SHALL COMPLY WITH INTERNATIONAL BUILDERS AND/ OR INTERNATIONAL RESIDENTIAL CODES

REVISIONS	
DATE:	REMARKS:

DATE: NOV 24, 2010	DESIGNED BY: RDS
SCALE: 1/4" = 1'-0	DRAWN BY: RDS
JOB NO.	CHECKED BY: RDS

Doug Stewart
4210 Stewart Lane
Perkinston, MS 39573
228/255-5259

doug's plan Service

PLANS FOR NEW SANCTUARY
6028 LAKESHORE ROAD
BAY ST LOUIS, MS 39520

LAKESHORE BAPTIST CHURCH
6028 LAKESHORE ROAD
BAY ST LOUIS, MS 39520

HATTAWAY ENGINEERING INCORPORATED
P.O. BOX 363 CARRIERE, MS 39426
PH. (601) 798-1978 FAX. UPON REQUEST
"ENGINEERING THE FUTURE"
"REMEMBERING THE PAST"